

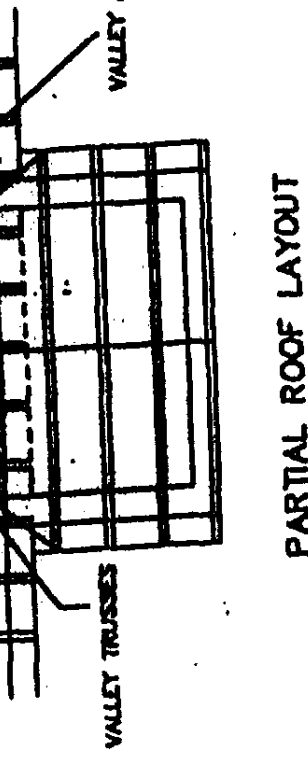


STANDARD ROOF VALLEY DETAIL

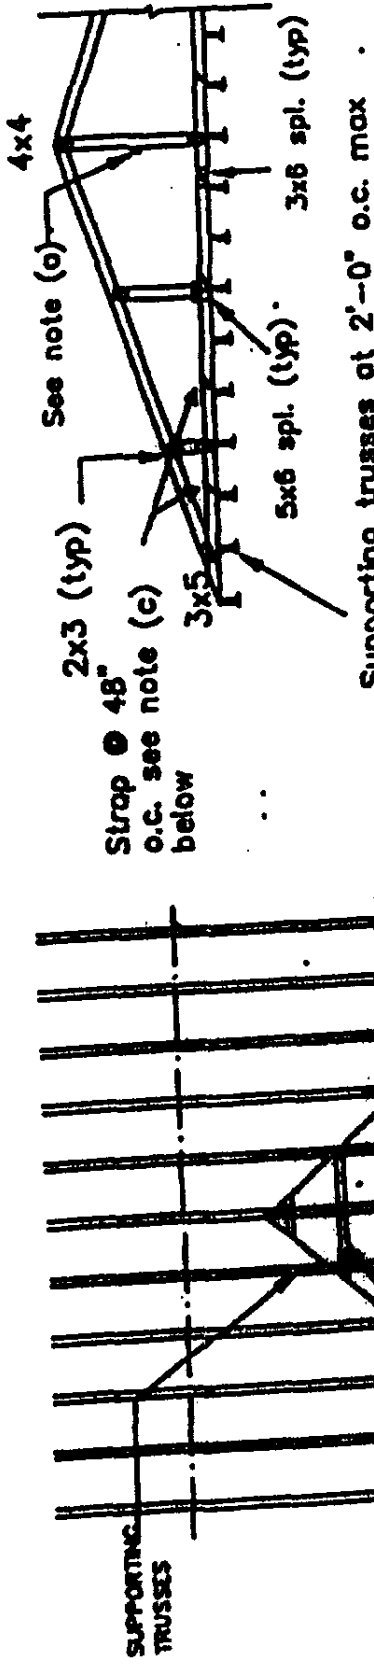

- NOTES:**
- Provide continuous bracing on verticals over 6'-3". Connect bracing to verticals w/2-5d nls and bracing must be tied to a fixed point at each end.
 - Max. spacing between vertical studs- 8'-0". On trusses with spans over 24'-0" the studs should be spaced at 6'-0" o.c. max.
 - Check for wind uplift w/ min. 1 1/4" 18 ga. test strip at 4'-0" intervals w/4, 10d nls each side of strip. Max 100 mph wind speed, 15'-0" max wall height.

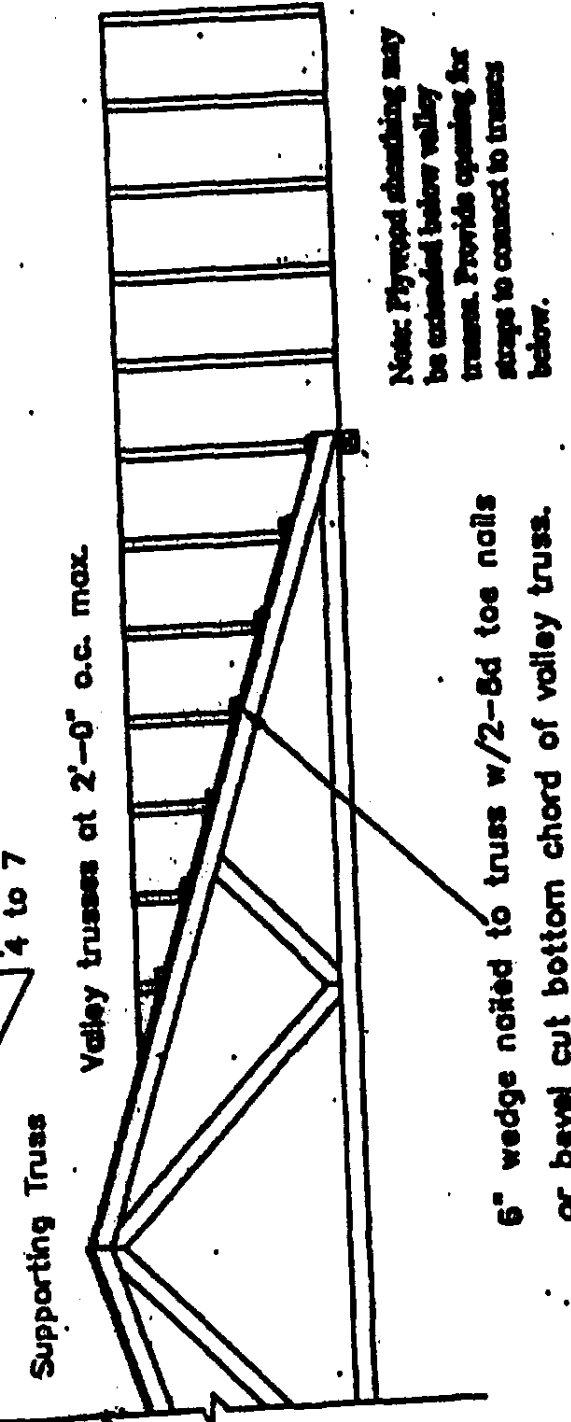

NOTES:

- Check for wind uplift w/ min. 1 1/4" 18 ga. test strip at 4'-0" intervals w/4, 10d nls each side of strip. Max 100 mph wind speed, 15'-0" max wall height.

REMBERTO CONTRERAS, PE
 Consulting Engineer/Structural
 30 N.W. 15th Ave., Suite 100
 Miami, FL 33137
 Phone: (305) 647-4797
 Fax: (305) 647-4798

STRUCTURES USA, INC.
 Truss Connectors
 (305) 740-5577
 1000 S.W. 10th Ave., Suite 100
 Miami, FL 33137