


DESIGN PRESSURE CHART - PSF										
WINDOW SIZE W X H INCHES	FTL-1419 316 TEmPERED GLASS		FTL-1420 316 TEmPERED 316 ANNEALED GLASS		FTL-1421 316 TEmPERED 316 ANNEALED GLASS		FTL-1422 316 TEmPERED 316 ANNEALED GLASS		FTL-1423 316 TEmPERED 316 ANNEALED GLASS	
	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.
120 X 40	96.94	96.94	—	—	—	—	—	—	—	—
120 X 37	100.00	104.15	—	—	—	—	—	—	—	—
120 X 26	100.00	140.59	—	—	—	—	—	—	—	—
120 X 19	100.00	186.29	55.55	55.55	—	—	—	—	—	—
108 X 46	90.00	90.00	—	—	—	—	—	—	—	—
108 X 40	100.00	100.00	—	—	—	—	—	—	—	—
108 X 37	100.00	106.30	—	—	—	—	—	—	—	—
108 X 26	100.00	142.51	—	—	—	—	—	—	—	—
108 X 19	100.00	188.09	61.89	61.89	—	—	—	—	—	—
96 X 50	82.80	82.80	—	—	—	—	—	—	—	—
96 X 46	90.00	90.00	—	—	—	—	—	—	—	—
96 X 40	100.00	102.93	—	—	—	—	—	—	—	—
96 X 37	100.00	109.12	—	—	—	—	—	—	—	—
96 X 26	100.00	144.99	48.82	48.82	—	—	—	—	—	—
96 X 19	100.00	190.39	64.84	64.84	—	—	—	—	—	—
91 X 54	76.67	76.67	—	—	—	—	—	—	—	—
91 X 50	82.80	82.80	—	—	—	—	—	—	—	—
91 X 46	90.00	90.00	—	—	—	—	—	—	—	—
91 X 40	100.00	103.50	—	—	—	—	—	—	—	—
91 X 37	100.00	110.57	—	—	—	—	—	—	—	—
91 X 26	100.00	146.25	49.81	49.81	—	—	—	—	—	—
91 X 19	100.00	191.54	65.23	65.23	—	—	—	—	—	—
84 X 58	71.38	71.38	—	—	—	—	—	—	—	—
84 X 54	76.67	76.67	—	—	—	—	—	—	—	—
84 X 50	82.80	82.80	—	—	—	—	—	—	—	—
84 X 46	90.00	90.00	—	—	—	—	—	—	—	—
84 X 40	100.00	103.50	—	—	—	—	—	—	—	—
84 X 37	100.00	111.89	—	—	—	—	—	—	—	—
84 X 26	100.00	148.31	50.51	50.51	—	—	—	—	—	—
84 X 19	100.00	193.42	65.67	65.67	—	—	—	—	—	—
78 X 63	65.71	65.71	—	—	—	—	—	—	—	—
78 X 58	71.38	71.38	—	—	—	—	—	—	—	—
78 X 54	76.67	76.67	—	—	—	—	—	—	—	—
78 X 50	82.80	82.80	—	—	—	—	—	—	—	—
78 X 46	90.00	90.00	—	—	—	—	—	—	—	—
78 X 40	100.00	103.50	—	—	—	—	—	—	—	—
78 X 37	100.00	111.89	—	—	—	—	—	—	—	—
78 X 26	100.00	150.43	51.23	51.23	—	—	—	—	—	—
78 X 19	100.00	195.34	65.52	65.52	—	—	—	—	—	—

DESIGN PRESSURE CHART - PSF									
WINDOW SIZE W X H INCHES	FTL-1419 316 TEMPERED GLASS		FTL-1420 316 TEMPERED 316 ANNEALED DSE GLASS		FTL-1421 316 TEMPERED 316 ANNEALED DSE GLASS		FTL-1422 316 TEMPERED 316 ANNEALED DSE GLASS		PSF
	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	
74 X 66	62.73	62.73	—	—	—	—	—	—	—
74 X 63	65.71	65.71	—	—	—	—	—	—	—
74 X 58	71.38	71.38	—	—	—	—	—	—	—
74 X 54	76.67	76.67	—	—	—	—	—	—	—
74 X 50	82.80	82.80	—	—	—	—	—	—	—
74 X 46	90.00	90.00	—	—	—	—	—	—	—
74 X 40	100.00	103.50	—	—	—	—	—	—	—
74 X 37	100.00	111.89	—	—	—	—	—	—	—
74 X 26	100.00	152.08	51.79	51.79	—	—	—	—	—
74 X 19	100.00	196.81	67.03	67.03	50.38	50.38	—	—	—
63 X 58	71.38	71.38	—	—	—	—	—	—	—
63 X 54	76.67	76.67	—	—	—	—	—	—	—
63 X 50	82.80	82.80	—	—	—	—	—	—	—
63 X 46	90.00	90.00	—	—	—	—	—	—	—
63 X 40	100.00	103.50	37.00	37.00	—	—	—	—	—
63 X 37	100.00	111.89	40.00	40.00	—	—	—	—	—
63 X 26	100.00	157.95	53.79	53.79	—	—	—	—	—
63 X 19	100.00	202.01	68.79	68.79	55.52	55.52	—	—	—
53 X 50	82.80	82.80	29.60	29.60	—	—	—	—	—
53 X 46	90.00	90.00	32.17	32.17	—	—	—	—	—
53 X 40	100.00	103.50	37.00	37.00	—	—	—	—	—
53 X 37	100.00	111.89	40.00	40.00	—	—	—	—	—
53 X 26	100.00	159.23	56.57	56.57	45.65	45.65	—	—	—
53 X 19	100.00	209.01	71.18	71.18	57.44	57.44	—	—	—
46 X 40	100.00	103.50	37.00	37.00	—	—	—	—	—
46 X 37	100.00	111.89	40.00	40.00	—	—	—	—	—
46 X 26	100.00	159.23	56.52	56.52	45.87	45.87	—	—	—
46 X 19	100.00	216.19	73.63	73.63	59.42	59.42	—	—	—
36 X 37	100.00	111.89	40.00	40.00	32.23	32.23	—	—	—
36 X 26	100.00	159.23	56.52	56.52	45.87	45.87	—	—	—
36 X 19	100.00	217.89	77.89	77.89	62.76	62.76	—	—	—
26 X 26	100.00	159.23	56.52	56.52	45.87	45.87	—	—	—
26 X 19	100.00	217.89	77.89	77.89	62.76	62.76	—	—	—

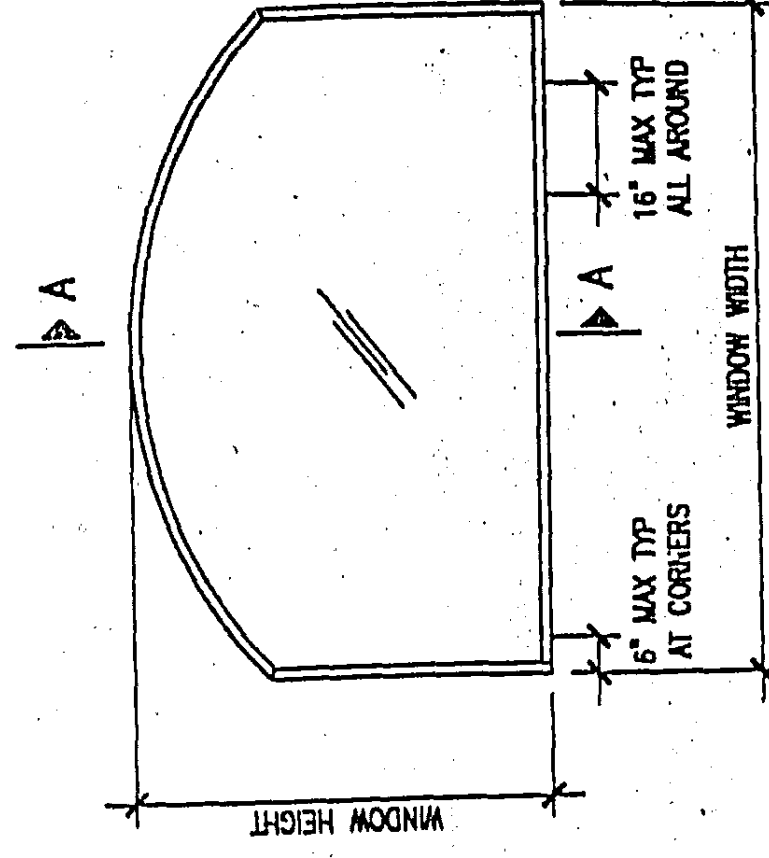

SIDEWAYS RECTANGLE WITH CIRCLE TOP
TYPICAL ELEVATION

FRANCISCO HERNANDEZ P. E.
Structural Engineering
351 NW 82nd Ave #1118
Miami, Florida 33126
Phone: (305) 266-3427
Fax: (305) 266-3427

Sunshine Windows
Manufacturing, Inc.
1745 W. 33rd Place
Miami, Florida 33133
Phone: (305) 252-3932
Fax: (305) 252-5118

SERIES 4250 ALUMINUM
CIRCLE TOP FIXED WINDOW

Drawn By: MH
Date: 9-15-00
Scale: 3/8\"/>

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE: 10/12/00
BY: *[Signature]*
PROJECT CONTROL ENGINEER
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0572.0

[Signature]
10-10-00
PROJECT CONTROL ENGINEER
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0572.0

EXAMINER: PW-00-02
SHEET 3 OF 5